



INTERNATIONAL TELECOMMUNICATION UNION

ITU-T

TELECOMMUNICATION
STANDARDIZATION SECTOR
OF ITU

K.45

(07/2003)

SERIES K: PROTECTION AGAINST INTERFERENCE

**Resistibility of telecommunication equipment
installed in the access and trunk networks to
overvoltages and overcurrents**

ITU-T Recommendation K.45

ITU-T Recommendation K.45

Resistibility of telecommunication equipment installed in the access and trunk networks to overvoltages and overcurrents

Summary

This Recommendation specifies resistibility requirements and test procedures for telecommunication equipment installed between Telecommunication Centres and between a Telecommunication Centre and Customer's premises building.

Overvoltages or overcurrents covered by this Recommendation include surges due to lightning on or near the line plant, short-term induction from adjacent a.c. power lines or railway systems, earth potential rise due to power faults, direct contacts between telecommunication lines and power lines and electrostatic discharges.

Major changes compared with the 2000 version of this Recommendation include:

- replacing the longitudinal test with a port to earth test;
- the introduction of an external port to port test.

Source

ITU-T Recommendation K.45 was approved by ITU-T Study Group 5 (2001-2004) under the ITU-T Recommendation A.8 procedure on 29 July 2003.

FOREWORD

The International Telecommunication Union (ITU) is the United Nations specialized agency in the field of telecommunications. The ITU Telecommunication Standardization Sector (ITU-T) is a permanent organ of ITU. ITU-T is responsible for studying technical, operating and tariff questions and issuing Recommendations on them with a view to standardizing telecommunications on a worldwide basis.

The World Telecommunication Standardization Assembly (WTSA), which meets every four years, establishes the topics for study by the ITU-T study groups which, in turn, produce Recommendations on these topics.

The approval of ITU-T Recommendations is covered by the procedure laid down in WTSA Resolution 1.

In some areas of information technology which fall within ITU-T's purview, the necessary standards are prepared on a collaborative basis with ISO and IEC.

NOTE

In this Recommendation, the expression "Administration" is used for conciseness to indicate both a telecommunication administration and a recognized operating agency.

Compliance with this Recommendation is voluntary. However, the Recommendation may contain certain mandatory provisions (to ensure e.g., interoperability or applicability) and compliance with the Recommendation is achieved when all of these mandatory provisions are met. The words "shall" or some other obligatory language such as "must" and the negative equivalents are used to express requirements. The use of such words does not suggest that compliance with the Recommendation is required of any party.

INTELLECTUAL PROPERTY RIGHTS

ITU draws attention to the possibility that the practice or implementation of this Recommendation may involve the use of a claimed Intellectual Property Right. ITU takes no position concerning the evidence, validity or applicability of claimed Intellectual Property Rights, whether asserted by ITU members or others outside of the Recommendation development process.

As of the date of approval of this Recommendation, ITU had not received notice of intellectual property, protected by patents, which may be required to implement this Recommendation. However, implementors are cautioned that this may not represent the latest information and are therefore strongly urged to consult the TSB patent database.

© ITU 2003

All rights reserved. No part of this publication may be reproduced, by any means whatsoever, without the prior written permission of ITU.

CONTENTS

	Page
1 Scope	1
2 References.....	1
3 Definitions and abbreviations	1
4 Tests.....	1

ITU-T Recommendation K.45

Resistibility of telecommunication equipment installed in the access and trunk networks to overvoltages and overcurrents

1 Scope

This Recommendation specifies resistibility requirements and test procedures for telecommunication equipment installed between Telecommunication Centres and between a Telecommunication Centre and Customer's premises building. Equipment which is attached to or installed within the Customer's premises building is outside the scope of this Recommendation. Basic ITU-T Rec. K.44 (test methods and test circuits) is an integral part of this Recommendation. It should be read in conjunction with ITU-T Recs K.11 and K.39 (technical and general economic aspects of protection).

2 References

The following ITU-T Recommendations and other references contain provisions which, through reference in this text, constitute provisions of this Recommendation. At the time of publication, the editions indicated were valid. All Recommendations and other references are subject to revision; users of this Recommendation are therefore encouraged to investigate the possibility of applying the most recent edition of the Recommendations and other references listed below. A list of the currently valid ITU-T Recommendations is regularly published. The reference to a document within this Recommendation does not give it, as a stand-alone document, the status of a Recommendation.

- ITU-T Recommendation K.11 (1993), *Principles of protection against overvoltages and overcurrents*.
- ITU-T Recommendation K.39 (1996), *Risk assessment of damages to telecommunication sites due to lightning discharges*.
- ITU-T Recommendation K.44 (2003), *Resistibility tests for telecommunication equipment exposed to overvoltages and overcurrents – Basic Recommendation*.
- IEC 61000-4-2 (1995), *Electromagnetic compatibility (EMC) – Part 4: Testing and measurement techniques – Section 2: Electrostatic discharge immunity test. Basic EMC publication*.

3 Definitions and abbreviations

Definitions, abbreviations and symbols used in this Recommendation are defined in ITU-T Rec. K.44.

4 Tests

A summary of the applicable tests is given in Table 1. The numbers given in the "Port type" columns, e.g., 2.2.1.a, refer to the "Test No." of Tables 2 to 5. The words "Under study" mean that the ITU-T is still studying this test. The test conditions applicable to the four ports (symmetric, coaxial, dedicated power feed and mains power) are given in Tables 2 to 5. The test conditions for ESD are given in Table 6. For information on the headings and terms used in the tables, refer to clause 10/K.44.

Refer to 5.2/K.44 on selecting the enhanced resistibility requirement.

NOTE 1 – The port to external port test, for the basic test level, does not apply when the equipment is designed to be always used with a connection to ground.

NOTE 2 – The external port test applies to ports used to connect equipment, attached externally to the building, to equipment installed within the same building. The mains power contact test does not apply in this situation.

Table 1/K.45 – Applicable tests

Test type	No. of ports simultaneously tested	Test connection	Primary protection	Port type			
				Symmetric port	Coaxial port	Dedicated power feed port	Mains power port
Lightning voltage	Single	Transverse	No	2.1.1.a		4.1.1.a	5.1.1.a
		Port to earth	No	2.1.1.b		4.1.1.b	5.1.1.b
		Port to external port	No	2.1.1.c		4.1.1.c	5.1.1.c
		Transverse	Yes	2.1.2.a		4.1.2.a	5.1.2.a
		Port to earth	Yes	2.1.2.b		4.1.2.b	5.1.2.b
		Port to external port	Yes	2.1.2.c		4.1.2.c	5.1.2.c
	Multiple	Port to earth	No	2.1.3.a		n.a.	n.a.
		Port to external port	No	2.1.3.b		n.a.	n.a.
		Port to earth	Yes	2.1.4.a		n.a.	n.a.
		Port to external port	Yes	2.1.4.b		n.a.	n.a.
Lightning current	Single	Port to earth	No	2.1.5.a		4.1.5.a	n.a.
		Port to external port	No	2.1.5.b		4.1.5.b	n.a.
	Multiple	Port to earth	No	2.1.6.a		n.a.	n.a.
		Port to external port	No	2.1.6.b		n.a.	n.a.
Power induction and earth potential rise	Single	Transverse	No	2.2.1.a		4.2.1.a	n.a.
		Port to earth	No	2.2.1.b		4.2.1.b	5.2.1 (Under study)
		Port to external port	No	2.2.1.c		4.2.1.c	5.2.1 (Under study)
		Transverse	Yes	2.2.2.a		4.2.2.a	n.a.
		Port to earth	Yes	2.2.2.b		4.2.2.b	n.a.
		Port to external port	Yes	2.2.2.c		4.2.2.c	
Neutral potential rise	Single	Port to earth	No	n.a.		n.a.	5.2.2.a
	Single	Port to external port	No	n.a.		n.a.	5.2.2.b
Mains power contact	Single	Transverse	No	2.3.1.a		4.3.1.a	n.a.
		Port to earth	No	2.3.1.b		4.3.1.b	n.a.
		Port to external port	No	2.3.1.c		4.3.1.c	n.a.
NOTE 1 – Coaxial ports are under study.							
NOTE 2 – There are no internal ports in access network equipment (due to its small physical size).							

Table 2a/K.45 – Lightning test conditions for ports connected to external symmetric pair cables

Test No.	Test description	Test circuit and waveshape (See figures in Annex A/K.44)	Basic test levels (Also see clause 7/K.44)	Enhanced test levels (Also see clauses 5 and 7/K.44)	No. of tests	Primary protection	Acceptance criteria	Comments
2.1.1.a	Single port, lightning, inherent, transverse	A.3-1 and A.6.1-1 (a and b) 10/700 μ s	$U_{c(max)} = 1.5$ kV $R = 25$ Ω	$U_{c(max)} = 1.5$ kV $R = 25$ Ω	5 of each polarity	None	A	This test does not apply when the equipment is designed to be always used with primary protection.
2.1.1.b	Single port, lightning, inherent, port to earth	A.3-1 and A.6.1-2 10/700 μ s	$U_{c(max)} = 1.5$ kV $R = 25$ Ω	$U_{c(max)} = 1.5$ kV $R = 25$ Ω	5 of each polarity	None	A	
2.1.1.c	Single port, lightning, inherent, port to external port	A.3-1 and A.6.1-3 10/700 μ s	$U_{c(max)} = 1.5$ kV $R = 25$ Ω	$U_{c(max)} = 1.5$ kV $R = 25$ Ω	5 of each polarity	None	A	
2.1.2.a	Single port, lightning, coordination, transverse	A.3-1 and A.6.1-1 (a and b) 10/700 μ s	$U_{c(max)} = 4$ kV $R = 25$ Ω	$U_{c(max)} = 4$ kV $R = 25$ Ω	5 of each polarity	Special test protector; see 8.4/K.44	A During the test the special test protector must operate at $U_c = U_{c(max)}$	When the equipment contains high current-carrying components which eliminate the need for primary protection, refer to 10.1.1/K.44.
2.1.2.b	Single port, lightning, coordination, port to earth	A.3-1 and A.6.1-2 10/700 μ s	$U_{c(max)} = 4$ kV $R = 25$ Ω	$U_{c(max)} = 4$ kV $R = 25$ Ω	5 of each polarity			
2.1.2.c	Single port, lightning, coordination, port to external port	A.3-1 and A.6.1-3 10/700 μ s	$U_{c(max)} = 4$ kV $R = 25$ Ω	$U_{c(max)} = 4$ kV $R = 25$ Ω	5 of each polarity			

Table 2a/K.45 – Lightning test conditions for ports connected to external symmetric pair cables

Test No.	Test description	Test circuit and waveshape (See figures in Annex A/K.44)	Basic test levels (Also see clause 7/K.44)	Enhanced test levels (Also see clauses 5 and 7/K.44)	No. of tests	Primary protection	Acceptance criteria	Comments
2.1.3.a	Multiple port, lightning, inherent, port to earth	A.3-1 and A.6.1-4 10/700 μ s	$U_{c(max)} = 1.5$ kV $R = 25$ Ω	$U_{c(max)} = 1.5$ kV $R = 25$ Ω	5 of each polarity	None	A	The multiple port test is simultaneously applied to 100% of the ports, limited to a maximum of 8 ports. This test does not apply when the equipment is designed to be always used with primary protection.
2.1.3.b	Multiple port, lightning, inherent, port to external port	A.3-1 and A.6.1-5 10/700 μ s	$U_{c(max)} = 1.5$ kV $R = 25$ Ω	$U_{c(max)} = 1.5$ kV $R = 25$ Ω	5 of each polarity	None	A	
2.1.4.a	Multiple port, lightning, port to earth	A.3-1 and A.6.1-4 10/700 μ s	$U_{c(max)} = 4$ kV $R = 25$ Ω	$U_{c(max)} = 6$ kV $R = 25$ Ω	5 of each polarity	Agreed primary protector	A	The multiple port test is simultaneously applied to 100% of the ports, limited to a maximum of 8 ports. When the equipment contains high current-carrying components which eliminate the need for primary protection, do not remove these components and do not add primary protection.
2.1.4.b	Multiple port, lightning, port to external port	A.3-1 and A.6.1-5 10/700 μ s	$U_{c(max)} = 4$ kV $R = 25$ Ω	$U_{c(max)} = 6$ kV $R = 25$ Ω	5 of each polarity	Agreed primary protector	A	

Table 2a/K.45 – Lightning test conditions for ports connected to external symmetric pair cables

Test No.	Test description	Test circuit and waveshape (See figures in Annex A/K.44)	Basic test levels (Also see clause 7/K.44)	Enhanced test levels (Also see clauses 5 and 7/K.44)	No. of tests	Primary protection	Acceptance criteria	Comments
2.1.5.a	Single port. lightning current, port to earth	A.3-4 and A.6.1-2 8/20 μ s	I = 1 kA/wire R = 0 Ω	I = 5 kA/wire R = 0 Ω	5 of each polarity	None	A	This test only applies when the equipment contains high current-carrying components which eliminate the need for primary protection. Do not remove these components. The multiple port test is simultaneously applied to 100% of the ports, limited to a maximum of 8 ports.
2.1.5.b	Single port. lightning current, port to external port	A.3-4 and A.5.1-3 8/20 μ s	I = 1 kA/wire R = 0 Ω	I = 5 kA/wire R = 0 Ω	5 of each polarity	None	A	
2.1.6.a	Multiple port. lightning current, port to earth	A.3-4 and A.6.1-4 8/20 μ s	I = 1 kA/wire Limited to 6 kA total R = 0 Ω	I = 5 kA/wire Limited to 30 kA total R = 0 Ω	5 of each polarity	None	A	
2.1.6.b	Multiple port. lightning current, port to external port	A.3-4 and A.6.1-5 8/20 μ s	I = 1 kA/wire Limited to 6 kA total R = 0 Ω	I = 5 kA/wire Limited to 30 kA total R = 0 Ω	5 of each polarity	None	A	

Table 2b/K.45 – Power induction and earth potential rise test conditions for ports connected to external symmetric pair cables

Test No.	Test description	Test circuit (See figures in Annex A/K.44)	Basic test levels (Also see clause 7/K.44)	Enhanced test levels (Also see clauses 5 and 7/K.44)	No. of tests	Primary protection	Acceptance criteria	Comments
2.2.1.a	Power induction, inherent, transverse	A.3-6 and A.6.1-1 (a and b)	$W_{sp(max)} = 0.2 A^2s$ Frequency = 16 $\frac{2}{3}$, 50 or 60 Hz $U_{a.c.(max)} = 600 V$	$W_{sp(max)} = 0.2 A^2s$ Frequency = 16 $\frac{2}{3}$, 50 or 60 Hz $U_{a.c.(max)} = 600 V$	5	None	A	This test does not apply when the equipment is designed to be always used with primary protection.
2.2.1.b	Power induction and earth potential rise, inherent, port to earth	A.3-6 and A.6.1-2	R = 600 Ω t = 0.2 s	R = 600 Ω t = 0.2 s	5	None	A	

Table 2b/K.45 – Power induction and earth potential rise test conditions for ports connected to external symmetric pair cables

Test No.	Test description	Test circuit (See figures in Annex A/K.44)	Basic test levels (Also see clause 7/K.44)	Enhanced test levels (Also see clauses 5 and 7/K.44)	No. of tests	Primary protection	Acceptance criteria	Comments
2.2.1.c	Power induction and earth potential rise, inherent, port to external port	A.3-6 and A.6.1-3			5	None	A	
2.2.2.a	Power induction, inherent/coordination, transverse	A.3-6 and A.6.1-1 (a and b)	$W_{sp(max)} = 1 \text{ A}^2\text{s}$ Frequency = $16^{2/3}$, 50 or 60 Hz $U_{a.c.(max)} = 600 \text{ V}$ $R = 600 \Omega$	$W_{sp(max)} = 10 \text{ A}^2\text{s}$ Frequency = $16^{2/3}$, 50 or 60 Hz $U_{a.c.(max)} = 1500 \text{ V}$ $R = 200 \Omega$ $t_{(max)} = 2 \text{ s}$ $t = \frac{W_{sp} \times R^2}{(U_{a.c.})^2} \quad (4-1)$ (Note 2)	5	Special test protector; see 8.4/K.44	A	When the equipment contains high current-carrying components which eliminate the need for primary protection, refer to 10.1.3/K.44.
2.2.2.b	Power induction and earth potential rise, inherent/coordination, port to earth	A.3-6 and A.6.1-2	$t = 1.0 \text{ s}$ (Note 1)		5		A	
2.2.2.c	Power induction inherent/coordination, port to external port	A.3-6 and A.6.1-3			5		A	

Table 2b/K.45 – Power induction and earth potential rise test conditions for ports connected to external symmetric pair cables

Test No.	Test description	Test circuit (See figures in Annex A/K.44)	Basic test levels (Also see clause 7/K.44)	Enhanced test levels (Also see clauses 5 and 7/K.44)	No. of tests	Primary protection	Acceptance criteria	Comments
2.3.1.a	Mains power contact, inherent, transverse	A.3-6 and A.6.1-1 (a and b)	$U_{a.c.} = 230$ V Frequency = 50 or 60 Hz $t = 15$ min for each test resistor $R = 10, 20, 40, 80, 160, 300, 600$ and 1000Ω .	$U_{a.c.} = 230$ V Frequency = 50 or 60 Hz $t = 15$ min for each test resistor $R = 10, 20, 40, 80, 160, 300, 600$ and 1000Ω . See acceptance criteria column.	1	None	For basic level: criterion B. For enhanced level: criterion A for test resistors 160, 300 and 600 Ω , criterion B for the other resistor.	In some situations the test may be performed with a reduced number of current limit resistors. Refer to item 11 of 7.2/K.44 and I.1.4/K.44 for guidance on selecting the necessary size of resistors. When the equipment is designed to be always used with primary protection, and the operator agrees, perform this test with the special test protector installed.
2.3.1.b	Mains power contact, inherent, port to earth	A.3-6 and A.6.1-2			1	None		
2.3.1.c	Mains power contact, inherent, port to external port	A.3.6 and A.5.1.3			See acceptance criteria column.	1		

NOTE 1 – The test conditions for test 2.2.2 (basic test level) may be adapted to the local conditions, by variation of the test parameters within the following limits, so that I^2t equal to $= 1 A^2s$ is fulfilled:

$U_{a.c.(max)} = 300$ V... 600 V, selected to meet local conditions;

$t \leq 1.0$ s, selected to meet local conditions;

$R \leq 600 \Omega$, is to be calculated according to Equation 4-2.

$$R = U_{a.c.(max)} \sqrt{\frac{t}{1A^2s}} \quad (4-2)$$

NOTE 2 – For test 2.2.2 (enhanced test level), the equipment shall comply with the specified criterion for all voltage/time combinations bounded (on and below) by the 10 A^2s voltage/time curve in Figure 1. The curve in Figure 1 is defined by Equation 4-1 and boundary conditions in this table.

**Table 3/K.45 – Test conditions for ports connected to external coaxial cables
(Under study)**

Table 4a/K.45 – Lightning test conditions for ports connected to external d.c. or a.c. dedicated power feeding cables

Test No.	Test description	Test circuit and waveshape (See figures in Annex A/K.44)	Basic test levels (Also see clause 7/K.44)	Enhanced test levels (Also see clauses 5 and 7/K.44)	No. of tests	Primary protection	Acceptance criteria	Comments
4.1.1.a	Single port, lightning, inherent, transverse	A.3-1 and A.6.1-1 (a and b) 10/700 μs	$U_{c(max)} = 1.5 \text{ kV}$ $R = 25 \text{ } \Omega$	$U_{c(max)} = 1.5 \text{ kV}$ $R = 25 \text{ } \Omega$	5 of each polarity	None	A	This test does not apply when the equipment is designed to be always used with primary protection.
4.1.1.b	Single port, lightning, inherent, port to earth	A.3-1 and A.6.1-2 10/700 μs	$U_{c(max)} = 1.5 \text{ kV}$ $R = 25 \text{ } \Omega$	$U_{c(max)} = 1.5 \text{ kV}$ $R = 25 \text{ } \Omega$	5 of each polarity	None	A	
4.1.1.c	Single port, lightning, inherent, port to external port	A.3-1 and A.6.1-3 10/700 μs	$U_{c(max)} = 1.5 \text{ kV}$ $R = 25 \text{ } \Omega$	$U_{c(max)} = 1.5 \text{ kV}$ $R = 25 \text{ } \Omega$	5 of each polarity	None	A	

Table 4a/K.45 – Lightning test conditions for ports connected to external d.c. or a.c. dedicated power feeding cables

Test No.	Test description	Test circuit and waveshape (See figures in Annex A/K.44)	Basic test levels (Also see clause 7/K.44)	Enhanced test levels (Also see clauses 5 and 7/K.44)	No. of tests	Primary protection	Acceptance criteria	Comments
4.1.2.a	Single port, lightning, coordination, transverse	A.3-1 and A.6.1-1 (a and b) 10/700 μ s	$U_{c(max)} = 4 \text{ kV}$ $R = 25 \Omega$	$U_{c(max)} = 4 \text{ kV}$ $R = 25 \Omega$	5 of each polarity	Special test protector	A During the test, the special test protector must operate at $U_c = U_{c(max)}$	When the equipment contains high current-carrying components which eliminate the need for primary protection, do not remove these components and do not add primary protection. During the test this protection must operate at $U_c = U_{c(max)}$. If the primary protector is a clamping type device, use the test circuit and test levels specified in test 4.1.5.
4.1.2.b	Single port, lightning, coordination, port to earth	A.3-1 and A.6.1-2 10/700 μ s	$U_{c(max)} = 4 \text{ kV}$ $R = 25 \Omega$	$U_{c(max)} = 4 \text{ kV}$ $R = 25 \Omega$	5 of each polarity	Special test protector		
4.1.2.c	Single port, lightning, coordination, port to external port	A.3-1 and A.6.1-3 10/700 μ s	$U_{c(max)} = 4 \text{ kV}$ $R = 25 \Omega$	$U_{c(max)} = 4 \text{ kV}$ $R = 25 \Omega$	5 of each polarity	Special test protector		
4.1.3	Multiple port, lightning, inherent, port to earth and port to external port		n.a.	n.a.				
4.1.4	Multiple port, lightning, port to earth and port to external port		n.a.	n.a.				
4.1.5.a	Single port, lightning current, port to earth	A.3-4 and A.6.1-2 8/20 μ s	$I = 1 \text{ kA/wire}$ $R = 0 \Omega$	$I = 5 \text{ kA/wire}$ $R = 0 \Omega$	5 of each polarity	None	A	This test only applies when the equipment contains high current-carrying components which eliminate the need for primary protection.
4.1.5.b	Single port, lightning current, port to external port	A.3-4 and A.6.1-3 8/20 μ s	$I = 1 \text{ kA/wire}$ $R = 0 \Omega$	$I = 5 \text{ kA/wire}$ $R = 0 \Omega$	5 of each polarity	None	A	
4.1.6	Multiple port, lightning current		n.a.	n.a.				

NOTE – As there is little knowledge of the agreed primary protector, it is not possible to give guidance. In the interim test conditions for symmetric pair ports have been provided.

Table 4b/K.45 – Power induction and earth potential rise test conditions for ports connected to external d.c. or a.c. dedicated power feeding cables

Test No.	Test description	Test circuit (See figures in Annex A/K.44)	Basic test levels (Also see clause 7/K.44)	Enhanced test levels (Also see clauses 5 and 7/K.44)	No. of tests	Primary protection	Acceptance criteria	Comments
4.2.1.a	Power induction, inherent, transverse	A.3-6 and A.6.1-1 (a and b)	$W_{sp(max)} = 0.2 \text{ A}^2\text{s}$ Frequency = $16 \frac{2}{3}$, 50 or 60 Hz	$W_{sp(max)} = 0.2 \text{ A}^2\text{s}$ Frequency = $16 \frac{2}{3}$, 50 or 60 Hz	5	None	A	This test does not apply when the equipment is designed to be always used with primary protection.
4.2.1.b	Power induction and earth potential rise, inherent, port to earth	A.3-6 and A.6.1-2	$U_{a.c.(max)} = 600 \text{ V}$ $R = 600 \Omega$ $t = 0.2 \text{ s}$	$U_{a.c.(max)} = 600 \text{ V}$ $R = 600 \Omega$ $t = 0.2 \text{ s}$	5	None	A	
4.2.1.c	Power induction and earth potential rise, inherent, port to external port	A.3-6 and A.6.1-3			5	None	A	

Table 4b/K.45 – Power induction and earth potential rise test conditions for ports connected to external d.c. or a.c. dedicated power feeding cables

Test No.	Test description	Test circuit (See figures in Annex A/K.44)	Basic test levels (Also see clause 7/K.44)	Enhanced test levels (Also see clauses 5 and 7/K.44)	No. of tests	Primary protection	Acceptance criteria	Comments
4.2.2.a	Power induction, inherent/coordination, transverse	A.3-6 and A.6.1-1 (a and b)	$W_{sp(max)} = 1 A^2s$ Frequency = 16 $\frac{2}{3}$, 50 or 60 Hz $U_{a.c.(max)} = 600 V$ $R = 600 \Omega$ $t = 1.0 s$ (Note 1)	$W_{sp(max)} = 10 A^2s$ Frequency = 16 $\frac{2}{3}$, 50 or 60 Hz $U_{a.c.(max)} = 1500 V$ $R = 200 \Omega$ $t_{(max)} = 2 s$ $t = \frac{W_{sp} \times R^2}{(U_{a.c.})^2} \quad (4-1)$ (Note 2)	5	Special test protector	A	When the equipment contains high current-carrying components which eliminate the need for primary protection, do not remove these components and do not add primary protection.
4.2.2.b	Power induction and earth potential rise, inherent/coordination, port to earth	A.3-6 and A.6.1-2			5	Special test protector	A	
4.2.2.c	Power induction and earth potential rise, inherent/coordination, port to external port	A.3-6 and A.6.1-3			5	Special test protector	A	

Table 4b/K.45 – Power induction and earth potential rise test conditions for ports connected to external d.c. or a.c. dedicated power feeding cables

Test No.	Test description	Test circuit (See figures in Annex A/K.44)	Basic test levels (Also see clause 7/K.44)	Enhanced test levels (Also see clauses 5 and 7/K.44)	No. of tests	Primary protection	Acceptance criteria	Comments
4.3.1.a	Mains power contact, inherent, transverse	A.3-6 and A.5.1-1 (a and b)	U _{a.c.} = 230 V Frequency = 50 or 60 Hz t = 15 min for each test resistor R = 10, 20, 40, 80, 160, 300, 600 and 1000 Ω. See acceptance criteria column.	U _{a.c.} = 230 V Frequency = 50 or 60 Hz t = 15 min for each test resistor R = 10, 20, 40, 80, 160, 300, 600 and 1000 Ω. See acceptance criteria column.	1	None	For basic level: criterion B. For enhanced level: criterion A for test resistors 160, 300 and 600 Ω; criterion B for the other resistor.	In some situations, the test may be performed with a reduced number of current limit resistors. Refer to item 11 of 7.2/K.44 and to I.1.4/K.44 for guidance on selecting the necessary size of resistors. When the equipment is designed to be always used with primary protection, and the operator agrees, perform this test with the special test protector installed.
4.3.1.b	Mains power contact, inherent, port to earth	A.3-6 and A.5.1-2						
4.3.1.c	Mains power contact, inherent, port to external port	A.3-6 and A.5.1-3			1	None		

Table 4b/K.45 – Power induction and earth potential rise test conditions for ports connected to external d.c. or a.c. dedicated power feeding cables

NOTE 1 – The test conditions for test 4.2.2 (basic test level) may be adapted to the local conditions, by variation of the test parameters within the following limits, so that I^2t equal to $= 1 \text{ A}^2\text{s}$ is fulfilled:

$U_{a.c.(max)} = 300 \text{ V} \dots 600 \text{ V}$, selected to meet local conditions;

$t \leq 1.0 \text{ s}$, selected to meet local conditions;

$R \leq 600 \Omega$, is to be calculated according to Equation 4-2.

$$R = U_{a.c.(max)} \sqrt{\frac{t}{1 \text{ A}^2\text{s}}} \quad (4-2)$$

NOTE 2 – For test 4.2.2 (enhanced test level) the equipment shall comply with the specified criterion for all voltage/time combinations bounded (on and below) by the $10 \text{ A}^2\text{s}$ voltage/time curve in Figure 1. The curve in Figure 1 is defined by Equation 4-1 and the boundary conditions in Table 4b.

Table 5/K.45 – Test conditions for mains power ports


Test No.	Test description	Test circuit and waveshape (See figures in Annex A/K.44)	Basic test levels (Also see clause 7/K.44)	Enhanced test levels (Also see clauses 5 and 7/K.44)	No. of tests	Primary protection	Acceptance criteria	Comments
5.1.1.a	Lightning, inherent, transverse	A.3-5 and A.6.4-1 combination wave	$U_{c(max)} = 2.5 \text{ kV}$ $R = 0 \Omega$	$U_{c(max)} = 6.0 \text{ kV}$ $R = 0 \Omega$	5 of each polarity	None	A	This test does not apply when the equipment is designed to be always used with primary protection.
5.1.1.b	Lightning, inherent, port to earth	A.3-5 and A.6.4-2 combination wave	$U_{c(max)} = 2.5 \text{ kV}$ $R = 0 \Omega$	$U_{c(max)} = 6.0 \text{ kV}$ $R = 0 \Omega$	5 of each polarity	None	A	
5.1.1.c	Lightning, inherent, port to external port	A.3-5 and A.6.4-3 combination wave	$U_{c(max)} = 2.5 \text{ kV}$ $R = 0 \Omega$	$U_{c(max)} = 6.0 \text{ kV}$ $R = 0 \Omega$	5 of each polarity	None	A	

Table 5/K.45 – Test conditions for mains power ports

Test No.	Test description	Test circuit and waveshape (See figures in Annex A/K.44)	Basic test levels (Also see clause 7/K.44)	Enhanced test levels (Also see clauses 5 and 7/K.44)	No. of tests	Primary protection	Acceptance criteria	Comments
5.1.2.a	Lightning, inherent/coordination, transverse	A.3-5 and A.6.4-1 combination wave	$U_{c(max)} = 6.0 \text{ kV}$ $R = 0 \ \Omega$	$U_{c(max)} = 10.0 \text{ kV}$ $R = 0 \ \Omega$	5 of each polarity	Agreed primary protector (mains)	A	
5.1.2.b	Lightning, inherent/coordination, port to earth	A.3-5 and A.6.4-2 combination wave	$U_{c(max)} = 6.0 \text{ kV}$ $R = 0 \ \Omega$	$U_{c(max)} = 10.0 \text{ kV}$ $R = 0 \ \Omega$	5 of each polarity	Agreed primary protector (mains)	A	
5.1.2.c	Lightning, inherent/coordination, port to external port	A.3-5 and A.6.4-3 combination wave	$U_{c(max)} = 6.0 \text{ kV}$ $R = 0 \ \Omega$	$U_{c(max)} = 10.0 \text{ kV}$ $R = 0 \ \Omega$	5 of each polarity	Agreed primary protector (mains)	A	
5.2.1	Earth potential rise		Under study	Under study	5	None	A	
5.2.2.a	Neutral potential rise, inherent, port to earth	A.3-6 and A.6.4-2 a.c.	$U_{a.c.} = 600 \text{ V}$ Frequency = 50 or 60 Hz $t = 1 \text{ s}$ $R = 200 \ \Omega$	$U_{a.c.} = 1500 \text{ V}$ Frequency = 50 or 60 Hz $t = 1 \text{ s}$ $R = 200 \ \Omega$	5	None	A	This test applies only when the equipment is to be installed with TT or IT mains system and the operator requests it.
5.2.2.b	Neutral potential rise, inherent, external port to port	A.3-6 and A.6.4-3 a.c.	$U_{a.c.} = 600 \text{ V}$ Frequency = 50 or 60 Hz $t = 1 \text{ s}$ $R = 200 \ \Omega$	$U_{a.c.} = 1500 \text{ V}$ Frequency = 50 or 60 Hz $t = 1 \text{ s}$ $R = 200 \ \Omega$	5	None	A	
NOTE – The total lead length used to connect the agreed primary protector shall be 1 m.								

Table 6/K.45 – Test conditions for ESD applied to the enclosure

Test No.	Test description	Test circuit	Basic test level	Enhanced test level	Number of tests	Primary protection	Acceptance criteria
6.1.a	air discharge	IEC 61000-4-2 (1995)	level 3	level 4	5	n.a.	A
6.1.b	contact discharge	IEC 61000-4-2 (1995)	level 3	level 4	5	n.a.	A
NOTE – The test applies to the equipment enclosure.							

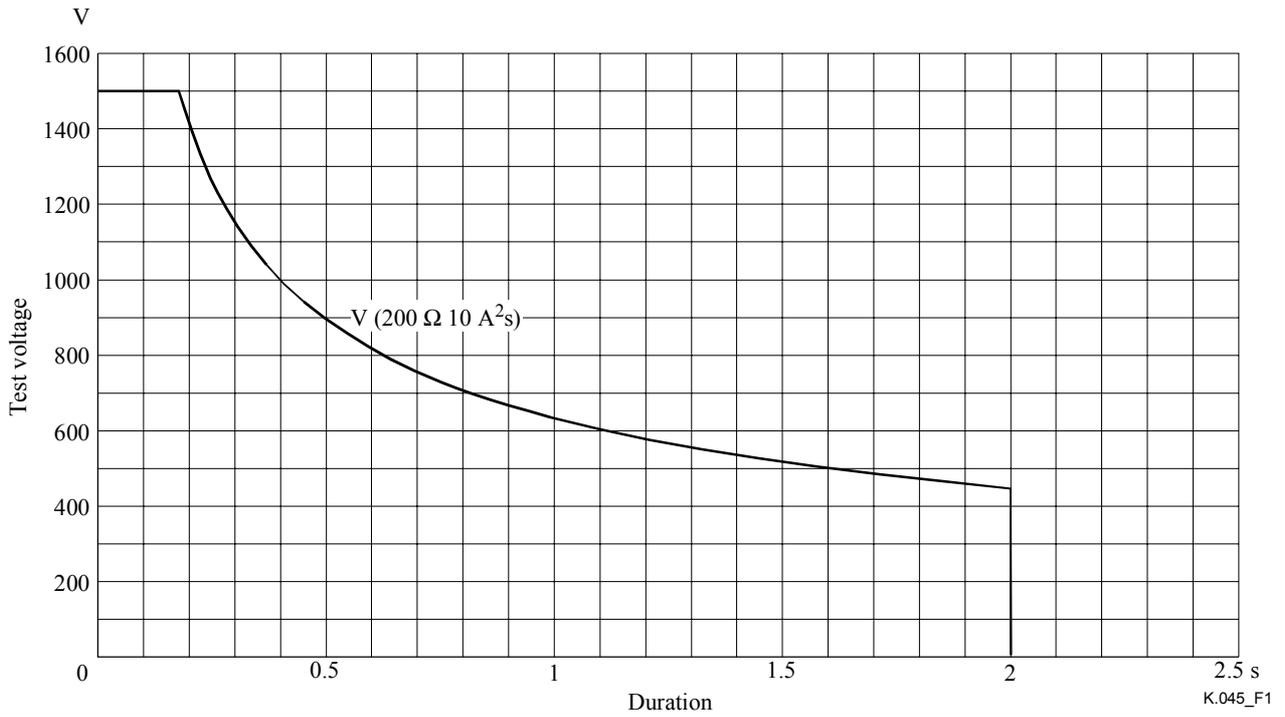

Test voltage versus duration for a specific energy and source resistance.

Figure 1/K.45 – Test voltage versus duration to give 10 A²s with 200 Ω

SERIES OF ITU-T RECOMMENDATIONS

Series A	Organization of the work of ITU-T
Series B	Means of expression: definitions, symbols, classification
Series C	General telecommunication statistics
Series D	General tariff principles
Series E	Overall network operation, telephone service, service operation and human factors
Series F	Non-telephone telecommunication services
Series G	Transmission systems and media, digital systems and networks
Series H	Audiovisual and multimedia systems
Series I	Integrated services digital network
Series J	Cable networks and transmission of television, sound programme and other multimedia signals
Series K	Protection against interference
Series L	Construction, installation and protection of cables and other elements of outside plant
Series M	TMN and network maintenance: international transmission systems, telephone circuits, telegraphy, facsimile and leased circuits
Series N	Maintenance: international sound programme and television transmission circuits
Series O	Specifications of measuring equipment
Series P	Telephone transmission quality, telephone installations, local line networks
Series Q	Switching and signalling
Series R	Telegraph transmission
Series S	Telegraph services terminal equipment
Series T	Terminals for telematic services
Series U	Telegraph switching
Series V	Data communication over the telephone network
Series X	Data networks and open system communications
Series Y	Global information infrastructure and Internet protocol aspects
Series Z	Languages and general software aspects for telecommunication systems