

International Telecommunication Union

ITU-T

TELECOMMUNICATION
STANDARDIZATION SECTOR
OF ITU

Series L

Supplement 8

(12/2014)

SERIES L: CONSTRUCTION, INSTALLATION AND
PROTECTION OF CABLES AND OTHER ELEMENTS
OF OUTSIDE PLANT

**ITU-T L.1300 – Supplement on potential for
primary energy savings in TLC/ICT centres
through free cooling**

ITU-T L-series Recommendations – Supplement 8

ITU-T



Supplement 8 to ITU-T L-series Recommendations

ITU-T L.1300 – Supplement on potential for primary energy savings in TLC/ICT centres through free cooling

Summary

Supplement 8 to the L series of Recommendations refers to the best practices defined in Recommendation ITU-T L.1300. More precisely, this Supplement first provides an introduction of potential for primary energy savings in TLC/ICT centres through the free cooling solution. Then, a probabilistic model for the inlet conditions is defined, and finally an analysis on room temperature and energy consumption is reported.

History

Edition	Recommendation	Approval	Study Group	Unique ID*
1.0	ITU-T L Suppl. 8	2014-12-19	5	11.1002/1000/12436

Keywords

Best practice, data centre, energy efficient, information and communication technology and climate change (ICT & CC).

* To access the Recommendation, type the URL <http://handle.itu.int/> in the address field of your web browser, followed by the Recommendation's unique ID. For example, <http://handle.itu.int/11.1002/1000/11830-en>.

FOREWORD

The International Telecommunication Union (ITU) is the United Nations specialized agency in the field of telecommunications, information and communication technologies (ICTs). The ITU Telecommunication Standardization Sector (ITU-T) is a permanent organ of ITU. ITU-T is responsible for studying technical, operating and tariff questions and issuing Recommendations on them with a view to standardizing telecommunications on a worldwide basis.

The World Telecommunication Standardization Assembly (WTSA), which meets every four years, establishes the topics for study by the ITU-T study groups which, in turn, produce Recommendations on these topics.

The approval of ITU-T Recommendations is covered by the procedure laid down in WTSA Resolution 1.

In some areas of information technology which fall within ITU-T's purview, the necessary standards are prepared on a collaborative basis with ISO and IEC.

NOTE

In this publication, the expression "Administration" is used for conciseness to indicate both a telecommunication administration and a recognized operating agency.

Compliance with this publication is voluntary. However, the publication may contain certain mandatory provisions (to ensure, e.g., interoperability or applicability) and compliance with the publication is achieved when all of these mandatory provisions are met. The words "shall" or some other obligatory language such as "must" and the negative equivalents are used to express requirements. The use of such words does not suggest that compliance with the publication is required of any party.

INTELLECTUAL PROPERTY RIGHTS

ITU draws attention to the possibility that the practice or implementation of this publication may involve the use of a claimed Intellectual Property Right. ITU takes no position concerning the evidence, validity or applicability of claimed Intellectual Property Rights, whether asserted by ITU members or others outside of the publication development process.

As of the date of approval of this publication, ITU had not received notice of intellectual property, protected by patents, which may be required to implement this publication. However, implementers are cautioned that this may not represent the latest information and are therefore strongly urged to consult the TSB patent database at <http://www.itu.int/ITU-T/ipr/>.

© ITU 2015

All rights reserved. No part of this publication may be reproduced, by any means whatsoever, without the prior written permission of ITU.

Table of Contents

	Page
1 Scope.....	1
2 Definitions	1
3 Abbreviations and acronyms	1
4 Introduction.....	1
5 Probabilistic model for the inlet conditions.....	2
5.1 Temperature model.....	2
5.2 Relative humidity model	4
6 Room temperature	5
7 Energy analysis.....	8
Bibliography.....	12

Supplement 8 to ITU-T L-series Recommendations

ITU-T L.1300 – Supplement on potential for primary energy savings in TLC/ICT centres through free cooling

1 Scope

This Supplement describes the potential for primary energy savings in TLC/ICT centres through free cooling based on Recommendation ITU-T L.1300. The scope of this Supplement includes:

- an introduction of potential for primary energy savings in TLC/ICT centres through free cooling;
- a probabilistic model for the inlet conditions; and
- a room temperature and energy analysis.

2 Definitions

This Supplement uses the following term:

2.1 power density: The energy consumption of ICT equipment per rack cabinet of floor area of a server room.

3 Abbreviations and acronyms

This Supplement uses the following abbreviations and acronyms:

COP Coefficient Of Performance

RH Relative Humidity

4 Introduction

The growth of modern society is characterized by dynamism in communications, and in recent years the field of telecommunications has achieved great importance in the socio-economic development of many countries. Such a trend requires increased power installation in data centres that serve to allocate routers, switches, computers, and many other equipment that have high energy requirements. Such data centres generate heat that must be dissipated. To give an example, the mean value of electrical power density installed in Italian telecommunication plants is about 450 W/m² and all this electrical power is converted into endogenous power.

In 2007, electrical energy consumption for Italian telecommunications was 4000 GWh, which is 1.25% of global electrical energy consumption for that year. Moreover, data shows that the global demand for electrical energy has increased by 0.4% with respect to 2006 data, but that the increase in telecommunications was 1.5%. The most important Italian telecommunication company is the second national user for energy consumption; with 0.7% of total national energy demand (the largest user is the national railway transport company). More than half of the energy consumption is used for fixed network and mobile equipment, and approximately 16% of this part is used for cooling.

In total, electrical energy purchased or generated by the group in 2007 amounts to 2.15 TWh, i.e., about 2.3% more than energy used in 2006, and 7.36% more than energy used in 2005. Equipment in data centres have to operate within defined temperature and humidity conditions, because their internal circuits are sensitive to excessively high or low temperature and humidity. Furthermore, the equipment cannot be switched off because data must be transmitted from centre to centre 24 hours a day, 7 days per week. ETSI standard [b-EN 300 019-1-3] establishes the upper and lower limits for temperature and humidity in which equipment must operate.

To maintain correct operating conditions, the cooling system must operate continuously, absorbing large amounts of electricity. To contribute to energy saving policies, such as the 20/20/20 objectives established by the European Commission, the use of alternative cooling systems for data centres air conditioning is crucial. Free cooling consists of the direct use of external air to cool the environment. The temperature of external air can be reduced by injecting water spray, if the external humidity is lower than 100%. This is called adiabatic free cooling. Free cooling is a rational option for the telecommunication sector, as the temperature tolerated in data centres is usually above outdoor temperature and because of the non-stop operation of the equipment. Knowledge of typical external temperature and relative humidity is particularly important for a correct design of a free cooling system. Such information is available for various locations, and otherwise a model may be used. A possible model is presented in the next clause. This is particularly useful because of the small number of parameters required for its application to a location. In addition, it provides a general behaviour that should be adopted for compact representation of the suitability of free cooling systems in a location.

This Supplement describes a general approach to the energy analysis of free cooling systems and its application to telecommunication centres located in Italy. In the mid-term it could also be applied to data centres. First, a probabilistic model for ambient temperature and relative humidity is presented. This is the basis for predicting the air inlet condition. Then some theoretical and experimental data obtained from measurements in the Telecom Italia telecommunication laboratory are presented. These data allow one to relate the inlet air condition to the operating conditions of the equipment. Ultimately, the energy savings that can be achieved through use of free cooling systems in Italy is calculated. Italian locations are classified in terms of energy saving due to free cooling and adiabatic free cooling use, and the opportunity of using such a technique is highlighted through a pictorial representation on the Mollier diagram, where the limits of the ETSI standard are also drawn. With respect to the ETSI diagram, here the properties of the probabilistic model of temperature and relative humidity are used for a more compact representation.

5 Probabilistic model for the inlet conditions

External air temperature and relative humidity (RH) define the applicability of free cooling. If the temperature is too high, a large air mass flow rate may be necessary to keep the internal temperature within acceptable limits. However, it may be impossible if the external temperature is above the maximum internal temperature. A model that represents the daily temperature (and RH) trend, allows temperature distribution to be foreseen for an assigned geographical site on the basis of little data, generally available for most locations. This model is composed of two parts. The first part is an equation that makes it able to describe hourly temperature and RH in the average day of each month. Then a stochastic model is applied in order to account for expected deviations.

5.1 Temperature model

The model is aimed at obtaining an average daily temperature trend for an assigned site and an assigned time step; temperature distribution has been described by simplified mathematical functions that require the lowest number of independent variables. The model has been generated thanks to a large amount of meteorological data referred to over a period of seven years. It has been created on the basis of data available from Turin. First, hourly data have been averaged to obtain 24 mean temperature values for every month (e.g., the value corresponding to the average temperature in January at 1 a.m. is obtained from the mean 31.7 temperatures recorded at 1 a.m.). The average temperature of a typical day of January is shown in Figure 1. Similar curves are obtained for the other months.

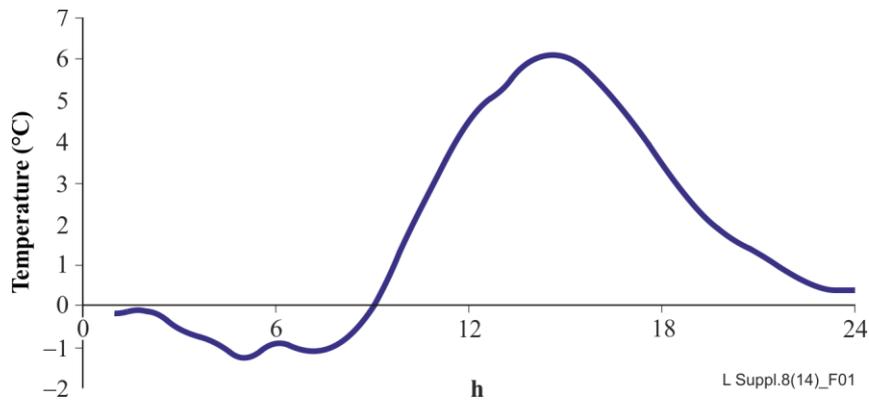


Figure 1 – Temperature for an average day of January

The model has been obtained by considering two different periods: daytime and night-time. The sequence of the hours, during the day, has been modified and fictitious time units have been used: the day starts at sunrise (the first hour is the hour corresponding to sunrise) and finishes at the hours that come before sunset. The first hour will be different for different geographical areas and for different months. Night-time starts at sunset. Figure 2 shows the shifted temperature curve and the two curves used for modelling daytime and night-time, which are described below.

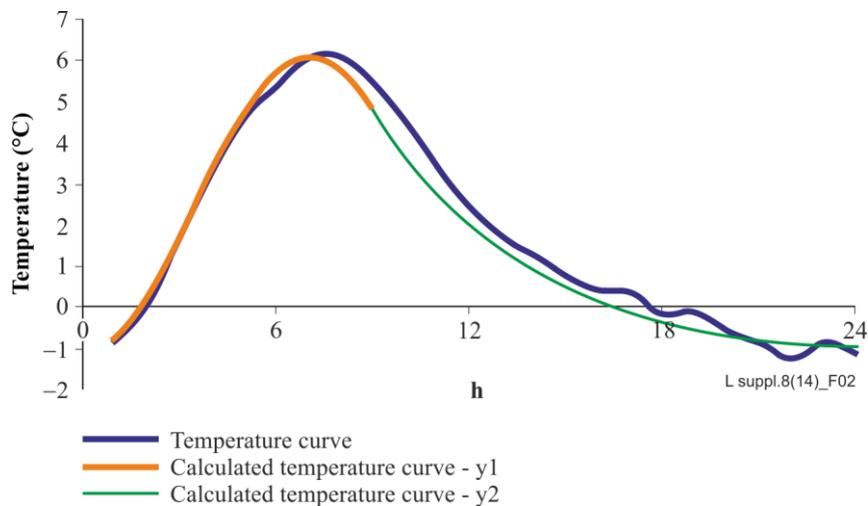


Figure 2 – Temperature in a typical day of January and model curves

A harmonic function is used to model the daytime temperature:

$$y_1 = A + B \cdot \sin(\omega \times x - k) \quad (5-1.1)$$

where A is the average between the maximum and minimum temperatures in an examined month; B is half of the difference between maximum and minimum temperatures; x is the current hour ($\text{sunrise} \leq x \leq \text{sunset}$); k is an empirical coefficient and its value is constant in every month; ω is the pulsation:

$$\omega = 2 \pi / (H \times FF) \quad (5-1.2)$$

where H refers to daylight time (from sunrise to sunset); FF is an empirical coefficient, that assumes two different values: in winter FF is equal to 1.6, otherwise it is equal to 1.45.

The curve corresponding to night-time is selected to describe the behaviour of a body that is losing heat, so it has been represented with an exponential function:

$$y_2 = b + (y_1(x_{\text{SUNSET}}) - b) \times \exp(h \times (x - x_{\text{SUNSET}})) \quad (5-1.3)$$

where b is the minimum average value of the temperature T_{min} , x_{SUNSET} is the actual sunset time, h is an empirical coefficient: its value is constant in every month and is equal to -0.231 , x is the current hour ($x > \text{sunset}$). Only 4 parameters are required to obtain an average temperature daily trend for the chosen location:

- 1) highest monthly temperature (average value);
- 2) lowest monthly temperature (average value);
- 3) latitude;
- 4) longitude.

Latitude and longitude are used to determine location sunrise and sunset times.

5.2 Relative humidity model

Daily average distribution of the relative humidity has been obtained in the same way as described in the temperature model. Figure 3 shows the relative humidity for an average day in January and the two curves are used to model the daytime portion and the night-time portion.

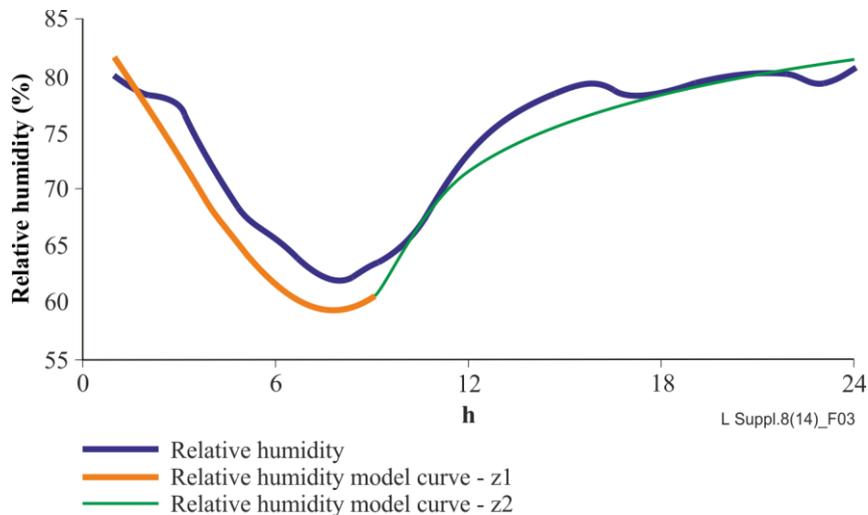


Figure 3 – Relative humidity for a typical day in January, plus model curves

The daytime portion has been represented with a harmonic function:

$$Z_1 = C + D \times (-\sin(\omega \times x - q)) \quad (5-2.1)$$

where C is the mean between the lowest and the highest relative humidity (average value), D is obtained from half of the difference between the lowest and highest relative humidity (average value), q is an empirical coefficient, and its value is equal to 0.8. Compared to the previous model, this coefficient differs due to the different way of calculating lowest and highest air relative humidity. Because of the difficulty in obtaining such information, data has been taken from the mean relative humidity value, lowest temperature (average value) and corresponding saturated steam pressure. On the basis of the average humidity value, corresponding water vapour ratio, x_M , has been calculated using the well-known expression:

$$x_M = 0.622 \times (\phi_M \times p_{vs}(T_M) / (p_{atm} - \phi_M \times p_{vs}(T_M))) \quad (5-2.2)$$

where ϕ_M is the average relative humidity, p_{vs} is the saturated steam pressure calculated at reference temperature, p_{atm} is the atmospheric pressure, and x_M is the water vapour ratio. Minimum and

maximum relative humidity have been calculated with the hypothesis of keeping a constant water vapour ratio:

$$\phi_{\min} = (p_{atm} \times x_M) / (0.622 \times p_{vs}(T_{\max}) + x_M \times p_{vs}(T_{\max})) \quad (5-2.3)$$

$$\phi_{\max} = (2 \times \phi_{\text{mean}}) - \phi_{\min} \quad (5-2.4)$$

The night-time portion has been modelled with a logarithmic function:

$$z_2 = z_1(x_{\text{SUNSET}}) + M \times \ln(x - x_{\text{SUNSET}}) + G \quad (5-2.5)$$

where G is an empirical coefficient equal to 4.5, while M is:

$$(z_1(x_{\text{SUNRISE}}) - z_1(x_{\text{SUNSET}}) - G) / \ln(24 - H) \quad (5-2.6)$$

Deviation analysis

The aim of this part of the model is to introduce deviations with respect to the average hourly temperature and the relative humidity trend.

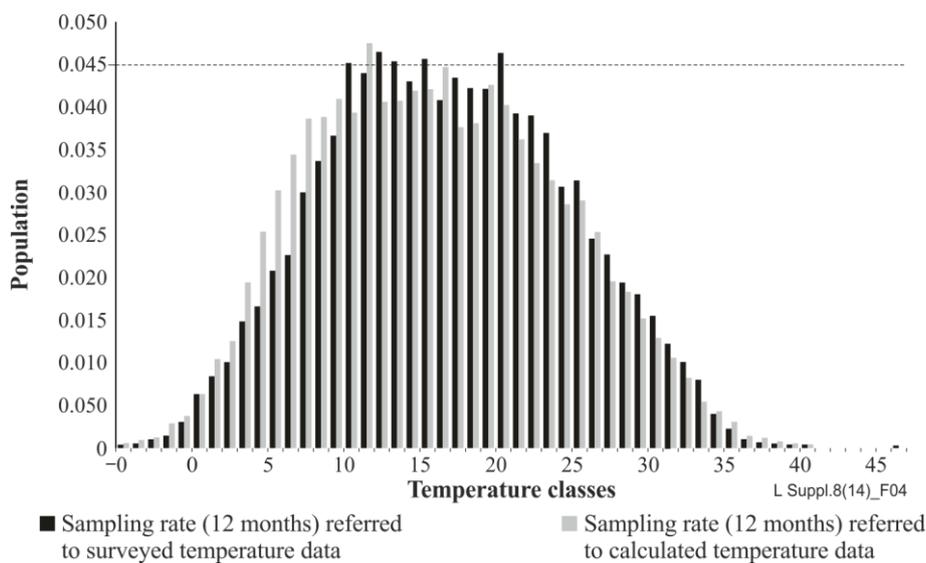


Figure 4 – Comparison between calculated and surveyed yearly temperature distributions

The relative frequency distribution of the differences has been approximated as a normal distribution. The standard deviation on difference between calculated mean values and real temperature and relative humidity values has been determined for Turin. The deviation for temperature is 3.5°C, while for humidity it is 15.5%. The model has been validated with available data for Rome and Palermo. Figure 4 shows a comparison between calculated temperature and modelled temperature for a year.

6 Room temperature

The cooling of data centre rooms depends on two different factors: external conditions and internal conditions. Meteorological models allow the forecasting of external factors in order to classify location on the basis of the operating conditions of equipment. When external air goes into areas, it exchanges heat with the air of the rooms that benefit from the exchange in different ways, according to different room configurations. For this reason, it is vital to know how external parameters need to be modified by referring to equipment suction conditions. A second model has been created to reproduce machine work modalities in Telecom Italia data centre rooms, located in Turin. Room pressure is less than outside pressure because external air has to enter and to cool the environment. The testing laboratory is divided into two contiguous parts (room 1 and room 2) divided by a watertight door. Room 1 is about three times wider than room 2, and has seven rows of racks containing equipment that differ for power. Room 2 is characterized by a large power density but,

compared to room 1, air entrance is penalized because of larger friction losses in the inlet air ducts. In room 2, there are four rows of racks and four air ducts for external air inlet. The layout is not optimum, because in the same passage there is equipment that expels air utilized for circuit cooling and also equipment that takes in air to cool the circuits. In this case, the second equipment will take in high temperature air. Room 2 has been selected for the analysis shown hereafter. The results of such an analysis are used as the reference for further considerations.

Four operating scenarios of the room are considered:

- 1) Ideal conditions are obtained by installing equipment of the same type with inlet vents all facing a cold aisle, and outlet vents facing a hot aisle. Fresh air enters from the ceiling above the cold aisle and exhaust air is extracted from the ceiling above the hot aisle. Figure 5 shows a schema of this configuration, which theoretically allows one to feed the racks with fresh air at the same temperature as the inlet temperature of the room. This scenario is the best one, but is not always applicable in real data centres, especially if there is equipment with the inlet vent on the same side as the outlet vent.

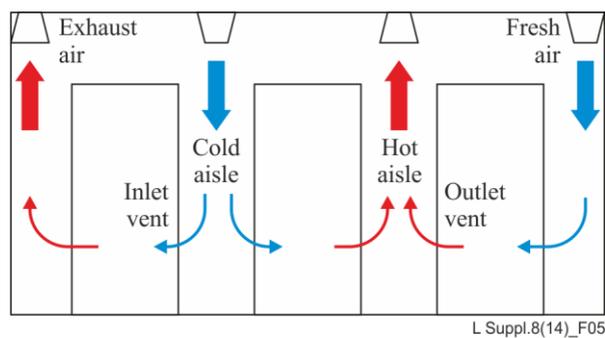


Figure 5 – Schema of air distribution according to configuration 1

- 2) Ideal conditions corresponding to perfect air mixing in the room. This means that the inlet temperature in the racks is equal to the exhaust air temperature (i.e., the temperature of air exiting the room). This temperature can be calculated as follows:

$$\Phi = m \times c \times (T_{ex} - T_{in}) \quad (6-1)$$

where Φ is the heat generation in the room (corresponding to the installed power capacity), m is the air mass flow rate, c is the air specific heat, T_{ex} is the exhaust air temperature and T_{in} is the fresh air temperature. If the system is sized with regard to a fresh airflow of 400 Nm³/h per kW of installed power, the temperature of air entering the racks is about 7.4°C higher than fresh air temperature.

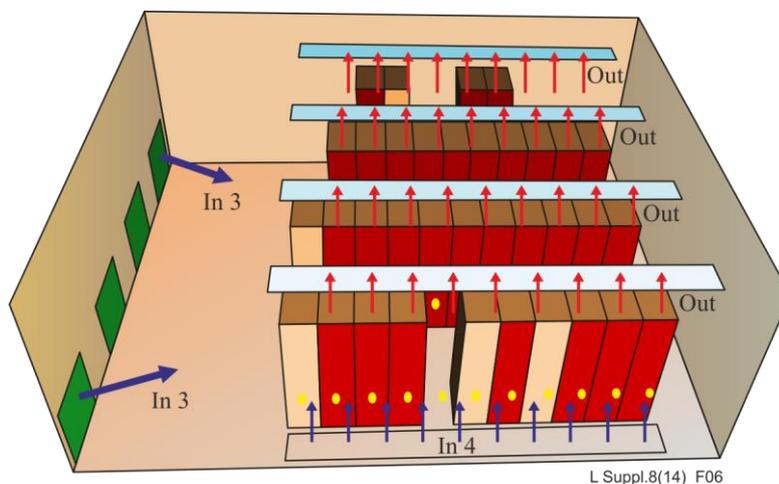


Figure 6 – Schema of air distribution in scenarios 3 and 4

- 3) Real conditions obtained by distributing fresh air from four large vents on a side wall. Two of these vents are indicated as "In 3" in Figure 6. These two vents supply about 13 500 Nm³/h of fresh air, which corresponds to 300 Nm³/h/kW. The other two vents, one of which is shown in Figure 7, are located on the opposite wall. These two vents supply about 1500 Nm³/h of fresh air, which corresponds to 33 Nm³/h/kW. Exhaust air is extracted from 36 vents on the ceiling. The temperature distribution corresponding to this scenario is shown in Figure 8. Temperatures have been measured in the aisles (10 measurements for each aisle) at 1 metre from the floor and then the distribution is obtained through interpolation. The maximum temperature is about 8.5°C higher than the fresh air temperature. This scenario is interesting as such a configuration may be easily obtained in a data centre.

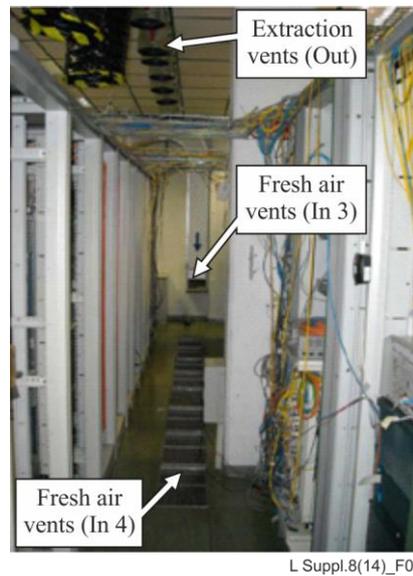


Figure 7 – Rack aisle and air distribution system

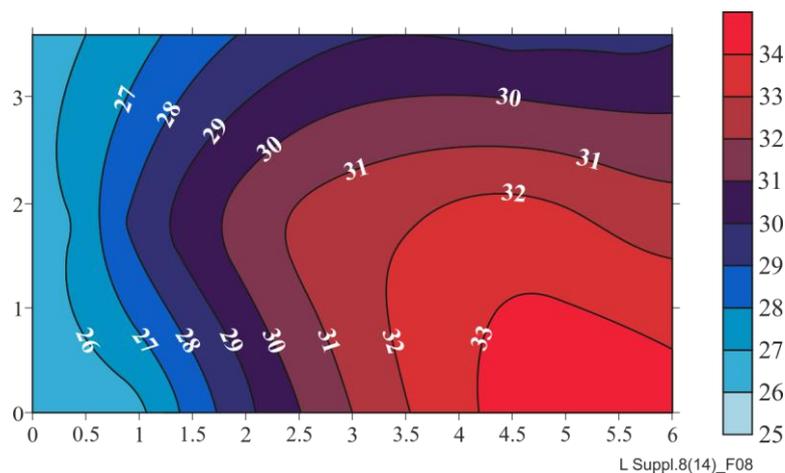


Figure 8 – Air temperature in scenario 3

- 4) Real condition obtained by distributing fresh air from distribution vents on the floor. The total amount of fresh air is the same as in scenario 3. Exhaust air is extracted from the vents on the ceiling as in scenario 3. Temperature distribution obtained from measurements at 1 metre from the floor, is shown in Figure 9. The maximum temperature is about 4.5°C higher than fresh air temperature. This scenario is not always applicable in data centres, as it requires distribution ducts below the floor.

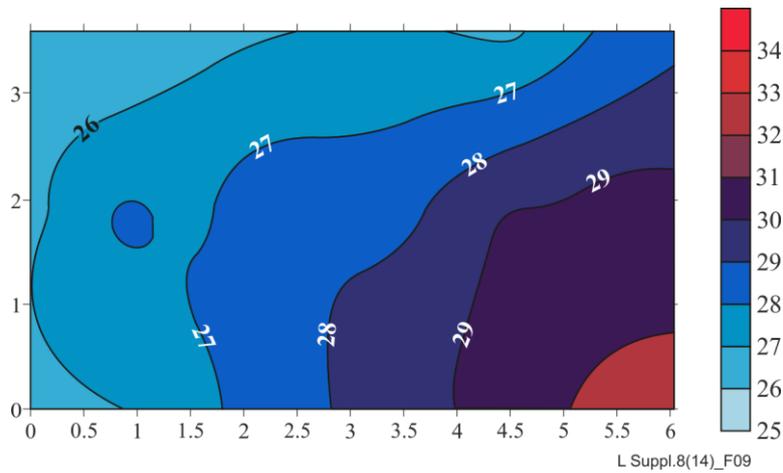


Figure 9 – Air temperature in scenario 4

7 Energy analysis

Energy analysis of free cooling systems is conducted considering the difference between fresh air temperature and inlet vent temperature as a parameter. Three cases are considered: $\Delta T = 0^{\circ}\text{C}$, $\Delta T = 4.5^{\circ}\text{C}$, $\Delta T = 8.5^{\circ}\text{C}$. Air temperature on the inlet vent of the racks is therefore calculated starting from the external temperature obtained through the probabilistic model and adding the ΔT corresponding with the examined scenario. Relative humidity is calculated starting from the ambient value and considering the effect due to ΔT . If the condition is within the limits of the ETSI diagram, only the fans of the free cooling system are used. On the basis of measurements conducted during tests, the electric power required by the fans at full load is about 1.9 kW. Clearly this value depends on the installation. For usual installations, ventilation power per installed power of the telecommunications equipment is expected to be smaller. When the point is outside the limits and it is possible to obtain acceptable operating conditions through adiabatic saturation, the humidification section (see Figure 10) is turned on. The measured electric power required by the water pumps is about 0.8 kW. Should such a process prove insufficient, the chillers are turned on. Chillers are characterized by an average coefficient of performance (COP) equal to 4.



L Suppl.8(14)_F10

Figure 10 – Filtration and humidification section

The results obtained for seven Italian towns are presented in Tables 1-3 for the various values of ΔT . In the case of $\Delta T = 0^\circ\text{C}$ and $\Delta T = 4.5^\circ\text{C}$, the free cooling system allows the equipment to comply with the ETSI standard [b-ETSI EN 300 019-1-3]. In fact, more than 90% of the inlet conditions are within the limits. In the case of $\Delta T = 8.5^\circ\text{C}$ only for Turin (located in northern Italy) the free cooling system is able to comply with the standard. For plants installed in Parma, Rome and Florence (all in central Italy) the standard is complied with, without using the chillers, as the combination of free cooling and adiabatic free cooling is sufficient to have more than 90% of the inlet conditions within the limits. For the last three towns, chillers are required.

Table 1 – System operation with $\Delta T = 0^\circ\text{C}$

Town	Free cooling	Adiabatic free cooling	Chillers
Turin	99.0%	0.0%	1.0%
Parma	99.0%	0.0%	1.0%
Rome	99.1%	0.0%	0.9%
Florence	98.2%	0.0%	1.7%
Foggia	97.9%	0.1%	2.0%
Olbia	98.2%	0.1%	1.7%
Catania	96.1%	0.0%	3.9%

Table 2 – System operation with $\Delta T = 4.5^\circ\text{C}$

Town	Free cooling	Adiabatic free cooling	Chillers
Turin	97.9%	0.1%	1.9%
Parma	96.3%	0.9%	2.8%
Rome	95.3%	1.3%	3.4%
Florence	94.4%	1.2%	4.4%
Foggia	93.5%	1.4%	5.1%
Olbia	94.3%	1.3%	4.5%
Catania	91.5%	1.1%	7.4%

Table 3 – System operation with $\Delta T = 8.5^\circ\text{C}$

Town	Free cooling	Adiabatic free cooling	Chillers
Turin	92.8%	1.7%	5.5%
Parma	87.7%	4.2%	8.1%
Rome	85.3%	5.3%	9.4%
Florence	86.6%	3.8%	9.7%
Foggia	84.3%	4.6%	11.2%
Olbia	85.0%	4.5%	10.5%
Catania	82.1%	4.1%	13.8%

A pictorial representation can be used to represent the opportunity of using free cooling and adiabatic free cooling in a data centre located in a specific place. This representation makes use of the temperature and relative humidity limits of the ETSI standard [b-ETSI EN 300 019-1-3] drawn on the Mollier diagram. In addition, the properties of the Gaussian distribution are considered. In this way a point corresponding to the average annual temperature and relative humidity guarantees that

90% of the points are within the limits, so that the standard is complied with. Figure 11 shows this representation for 106 Italian towns.

Circles refer to $\Delta T = 0^\circ\text{C}$, crosses to $\Delta T = 4.5^\circ\text{C}$ and triangles to $\Delta T = 8.5^\circ\text{C}$. Points within the curves marked in red mean that the free cooling system is able to comply with the limits. All towns except one (Lampedusa, which is an island in the middle of the Mediterranean sea) are within the limits, with $\Delta T = 0^\circ\text{C}$. If a $\Delta T = 4.5^\circ\text{C}$ is considered, about half the towns require additional cooling systems, while considering $\Delta T = 8.5^\circ\text{C}$ most towns need them. The farther the point is from the curve, the larger is the additional cooling to be supplied with chillers.

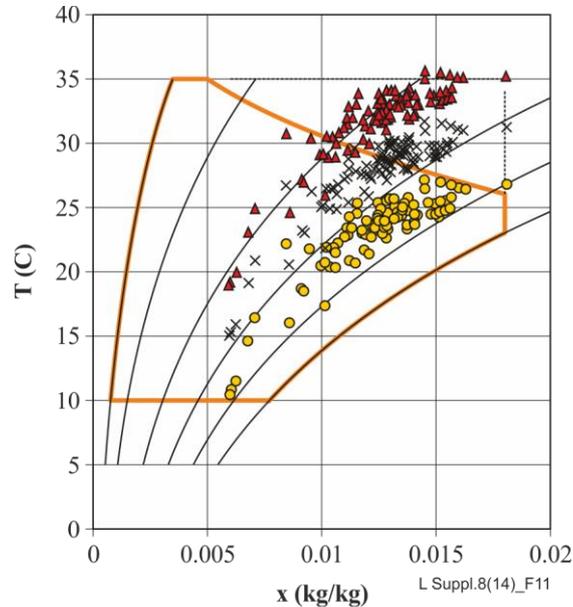


Figure 11 – Italian towns on the modified ETSI diagram

Table 4 shows the energy savings obtained for the seven towns using the free cooling and the adiabatic free cooling systems as much as possible. Calculations have been performed, considering the goal of 90% of the points within the limits of allowed operating conditions. The cooling load Q is obtained as:

$$Q = Q_{en} - k \cdot V \cdot \sum_{i=1}^{365} (T_{room} - T_{ext})_i \cdot 24$$

where Q_{en} is the endogenous heat generation (a constant power of 45 kW is considered in calculations), k is the volumetric heat transfer coefficient ($0.9 \cdot 10^{-3} \text{ kW}/(\text{m}^3\text{K})$), V is the room volume, T_{room} is the daily average internal temperature and T_{ext} is the daily average ambient temperature. This model has been used with the intention of creating a simple reference for calculating the energy savings. While designing a specific system, a detailed analysis is required.

Primary energy consumptions and savings are calculated considering the average efficiency of power plants installed in Italy, (about 0.46). Energy saving is the same with $\Delta T = 0^{\circ}\text{C}$ and $\Delta T = 4.5^{\circ}\text{C}$ as only the free cooling system is used. This amount is larger for towns in the south part as the cooling load is larger. In the case of $\Delta T = 8.5^{\circ}\text{C}$ energy savings reduce for all towns except Turin, where the free cooling system is sufficient to comply with the standards. In the case of Catania for instance, a reduction of about 29 MWh occurs.

Table 4 – Energy saving obtained with the free cooling + the adiabatic free cooling system

Town	Primary energy consumption with chillers (kWh)	Primary energy saving (kWh)		
		$\Delta T = 0^{\circ}\text{C}$	$\Delta T = 4.5^{\circ}\text{C}$	$\Delta T = 8.5^{\circ}\text{C}$
Turin	174157	140942	140942	140942
Parma	175409	142195	142195	140889
Rome	177439	144224	144224	143241
Florence	176835	143620	143620	142925
Foggia	177655	144440	144440	120190
Olbia	178562	145347	145347	122389
Catania	178994	145779	145779	117027

Bibliography

- [b-ITU-T L.1300] Recommendation ITU-T L.1300 (2011), *Best practices for green data centres*.
- [b-ETSI EN 300 019-1-3] ETSI EN 300 019-1-3 (1992), *Environmental Engineering (EE); Environmental conditions and environmental tests for telecommunications equipment; Part 1-3: Classification of environmental conditions; Stationary use at weather protected locations*.

SERIES OF ITU-T RECOMMENDATIONS

Series A	Organization of the work of ITU-T
Series D	General tariff principles
Series E	Overall network operation, telephone service, service operation and human factors
Series F	Non-telephone telecommunication services
Series G	Transmission systems and media, digital systems and networks
Series H	Audiovisual and multimedia systems
Series I	Integrated services digital network
Series J	Cable networks and transmission of television, sound programme and other multimedia signals
Series K	Protection against interference
Series L	Environment and ICTs, climate change, e-waste, energy efficiency; construction, installation and protection of cables and other elements of outside plant
Series M	Telecommunication management, including TMN and network maintenance
Series N	Maintenance: international sound programme and television transmission circuits
Series O	Specifications of measuring equipment
Series P	Terminals and subjective and objective assessment methods
Series Q	Switching and signalling
Series R	Telegraph transmission
Series S	Telegraph services terminal equipment
Series T	Terminals for telematic services
Series U	Telegraph switching
Series V	Data communication over the telephone network
Series X	Data networks, open system communications and security
Series Y	Global information infrastructure, Internet protocol aspects and next-generation networks
Series Z	Languages and general software aspects for telecommunication systems